


**Front view**




**Side view**

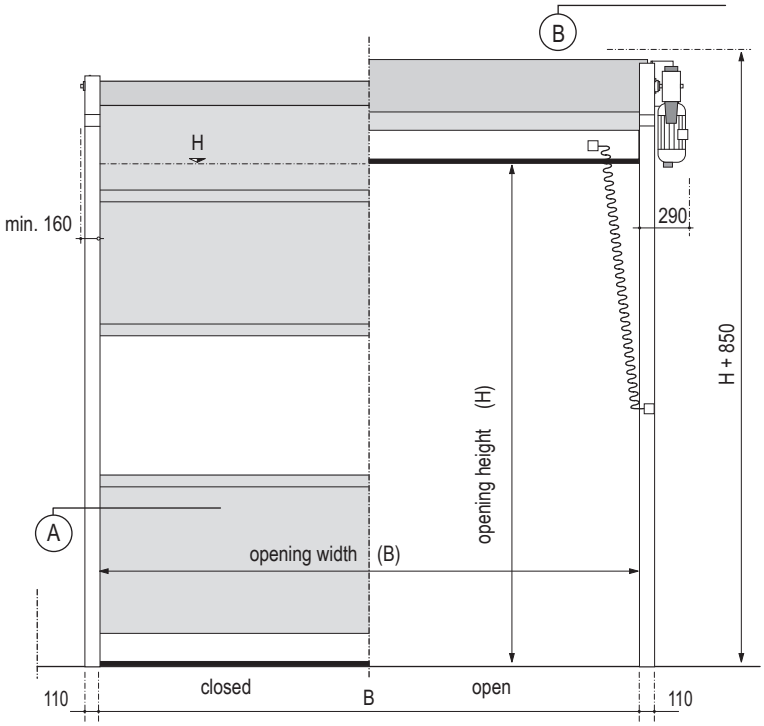


**Section A** **Section B**

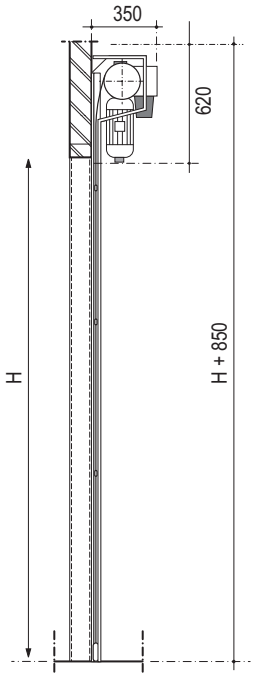


**Novo Speed Polara**

Minimum requirement for installation




Control box with contactors :
☐ CEE-form 3~N PE 400V/50Hz/16A

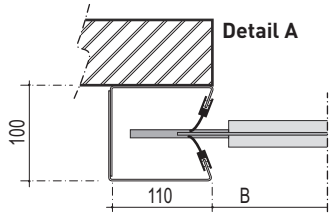Control box with frequency inverter :
☐ in case of 1,2 mm panel and WxH < 16 m²
CEE-form 1x230V/50Hz/T16A
☐ in case of 1,2 mm panel and WxH ≥ 16 m²
or in case of 3 mm panel
3~N PE 400V/50Hz/T16A

☐ Electrical supply by others

☐ control box/ power supply, inside RIGHT
☐ control box/ power supply, inside LEFT

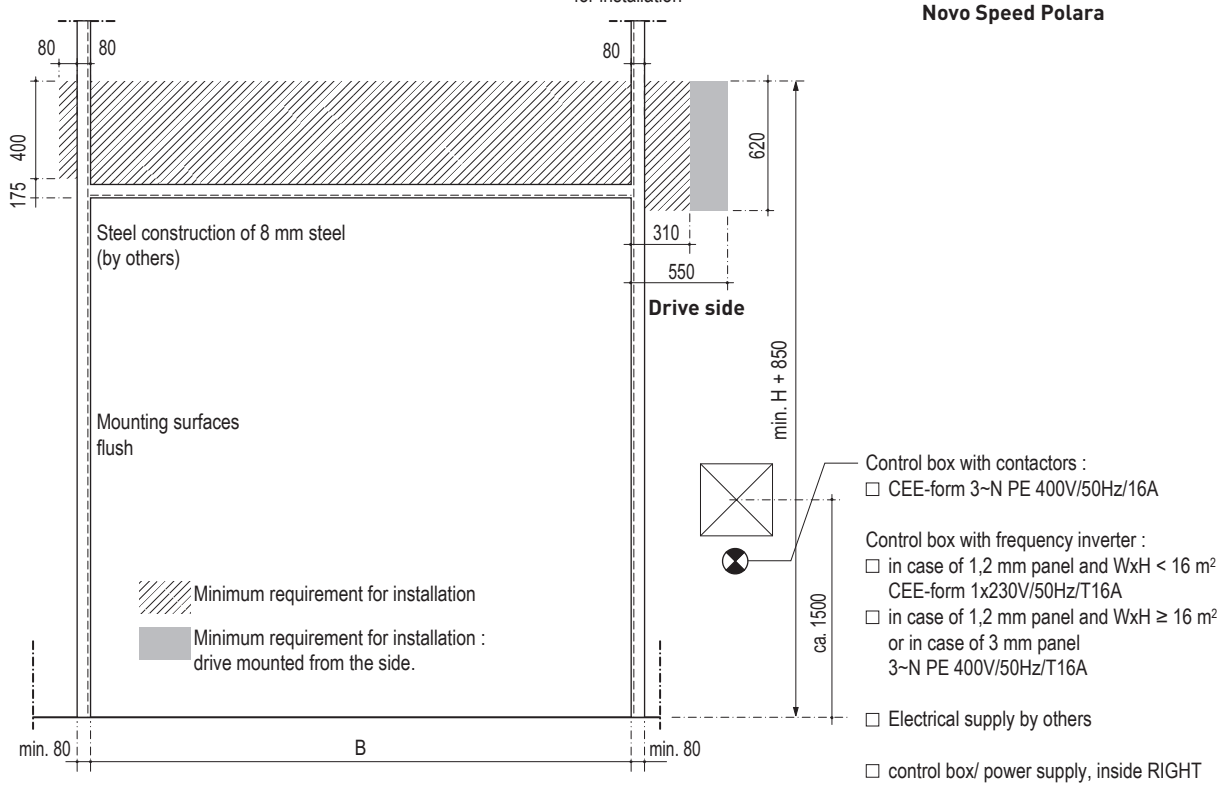**Installation requirements**


technical alterations and printing errors reserved